



SIDE VIEW
1 : 15

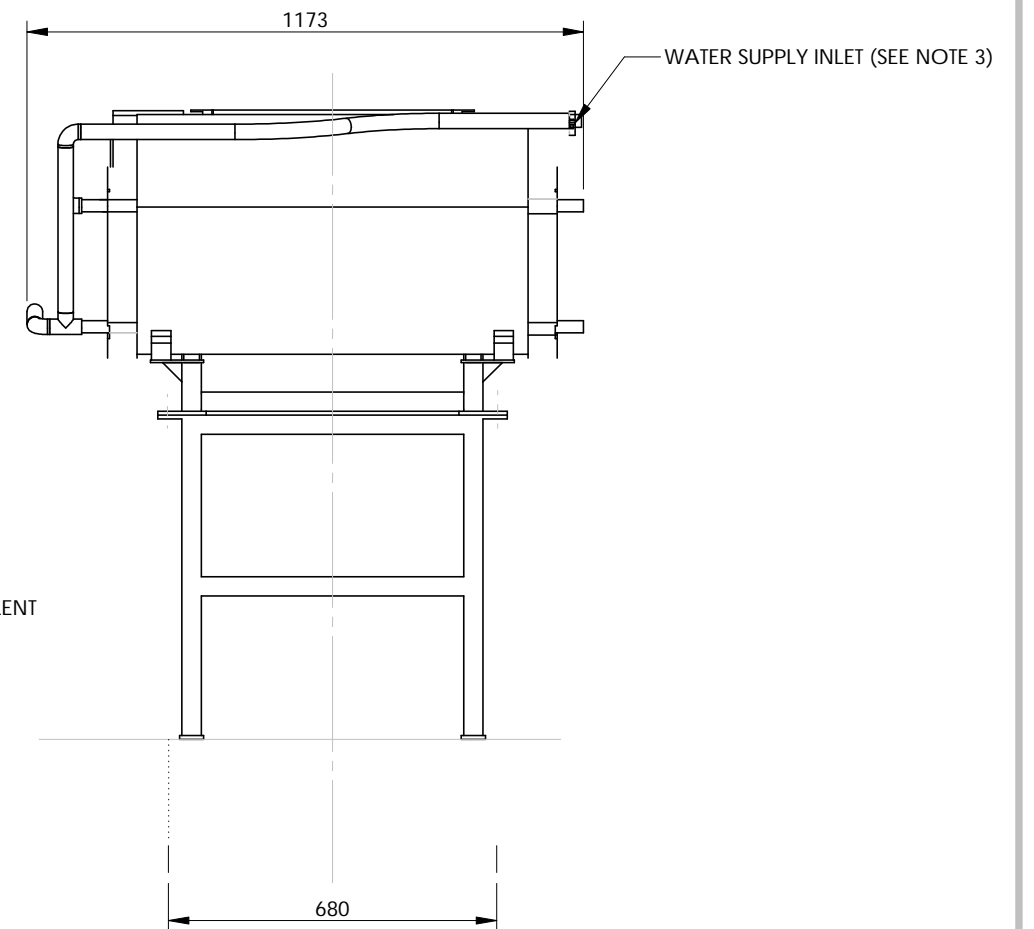

FRONT VIEW
1 : 15

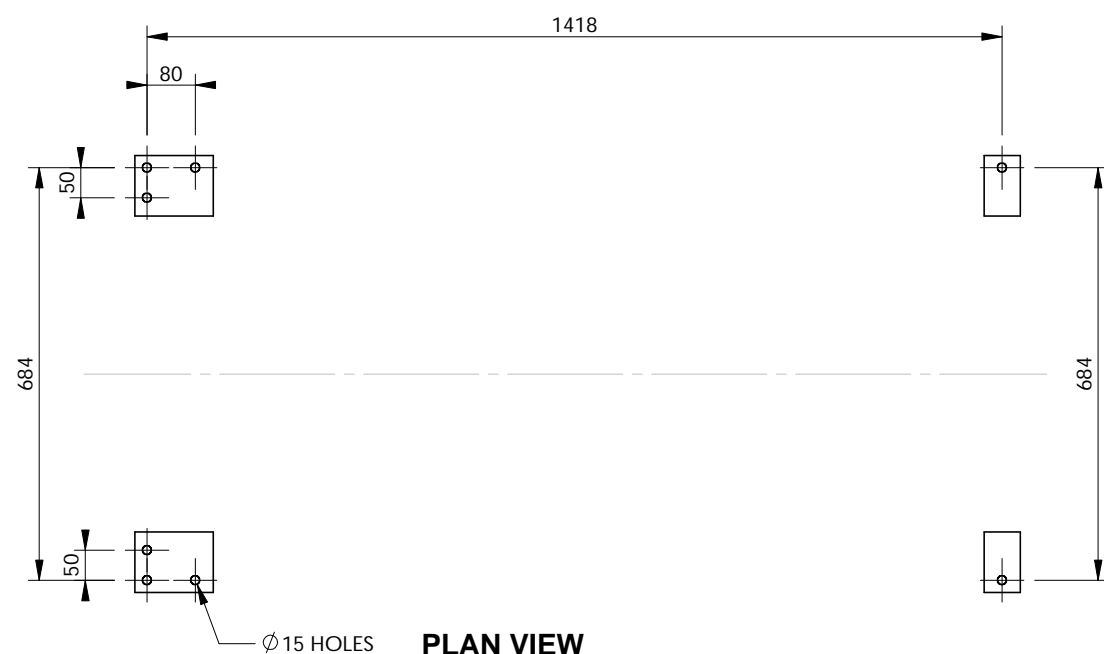

PLAN VIEW
1 : 12
MOUNTING HOLE POSITIONS ONLY

NOTES :

- 1) INLET FLOW IS EITHER GRAVITY FED OR PUMPED TO HEADER TANK (VIA WASTE WATER INLET) AND FILTRATE FLOW TO COLLECTION POINT IS BY GRAVITY.
 - 2) A SELF DRAINING SKIP (OR SUITABLE MECHANICAL EQUIVALENT) IS REQUIRED FOR "SPADE-ABLE" SOLIDS COLLECTION AND A MIST COVER (OR HOOD) IS REQUIRED AT FRONT OR UNIT.
 - 3) ALL ANCILLARY WORKS (PIPING, SERVICES, SUMP, SHED, SUPPORT SLAB, SOLIDS SKIP, ETC) TO BE SUPPLIED AND INSTALLED BY THE CLIENT.
 - 4) SERVICES REQUIRED TO OPERATE THE FILTER ARE PROVIDED BY THE PUMP CONTROL UNIT (REFER TO INSTALLATION PROFORMA) OUTLET CONNECTIONS
 - 5) SUBFRAME IS PROVIDED BY CLIENT AND MUST INCLUDE PROVISIONS FOR DIRECTING THE FILTRATE TO THE COLLECTION SUMP (OR DRAIN).
 - 6) GUARDING OF FILTER MECHANISM IS STRONGLY RECOMMENDED TO ENSURE AGAINST INJURY BY TRAVEL OF THE FILTER MECHANISM CARRIAGE.
 - 7) SECURING THE FILTER MECHANISM TO A RIGID NON-VIBRATIONAL STRUCTURE (OR FOUNDATION) IS RECOMMENDED.
 - 8) WATER FROM DEWATERING SOLIDS COLLECTION SKIP MAY BE DIRECTED EITHER TO FILTRATE OR TO OTHER SUITABLE LOCATION (SUBJECT TO SITE SURVEY).
 - 9) FINAL SPECIFICATIONS ARE BASED ON INDIVIDUAL SITE REQUIREMENTS.
 - 10) UPSTREAM PRETREATMENTS AND INFLUENT BALANCING MAY BE REQUIRED (SUBJECT TO SITE SURVEY).
- FOR FURTHER INFORMATION PLEASE CONTACT YOUR LOCAL BALEEN REPRESENTATIVE.

DRAWN	SER	BALEEN FILTERS PTY LTD	DESCRIPTION	PROJECT
DATE	25/04/03		BASIC FILTER UNIT INSTALLATION PROFORMA	B2
CHECKED	YRO	168 Melbourne Street, North Adelaide SA 5006 AUSTRALIA Tel: +61 8 8239 2422 Fax: +61 8 8239 0722 email: info@baleenfilters.com	DRG No.	REV
DATE	25/04/03		B0505S	FINAL